

| DOOR NO. | LOCATION | DOOR SIZE | MATERIAL | FINISH | TYPE | FRAME | | | HDWE. GROUP | SUP. BY | INST. BY | REMARKS |
|----------|-------------|-------------------------------|--------------|----------------------------|------|--------------|----------------------------|--------|-------------|---------|----------|--|
| | | | | | | MATERIAL | FINISH | DETAIL | | | | |
| 1 | STOREFRONT | EXIST. 3'-0" X 8'-0" X 1 3/4" | EXISTING | EXISTING | - | EXISTING | EXISTING | - | 1 | - | - | EXISTING HARDWARE TO REMAIN (SEE HARDWARE GROUP) - ENSURE DOOR AND HARDWARE ARE FULLY OPERATIONAL AND REPAIR AS REQUIRED |
| 2 | STOREFRONT | EXIST. 3'-0" X 8'-0" X 1 3/4" | EXISTING | EXISTING | - | EXISTING | EXISTING | - | 1 | - | - | EXISTING HARDWARE TO REMAIN (SEE HARDWARE GROUP) - ENSURE DOOR AND HARDWARE ARE FULLY OPERATIONAL AND REPAIR AS REQUIRED |
| 3 | STOCK ROOM | EXIST. 3'-0" X 6'-8" X 1 3/4" | EXISTING | MATCH ADJACENT WALL FINISH | - | EXISTING | MATCH ADJACENT WALL FINISH | - | 2 | G.C. | G.C. | EXISTING HARDWARE TO REMAIN (SEE HARDWARE GROUP) - ENSURE DOOR AND HARDWARE ARE FULLY OPERATIONAL AND REPAIR AS REQUIRED |
| 4 | TOILET ROOM | EXIST. 3'-0" X 6'-8" X 1 3/4" | EXISTING | MATCH ADJACENT WALL FINISH | - | EXISTING | MATCH ADJACENT WALL FINISH | - | 3 | G.C. | G.C. | EXISTING HARDWARE TO REMAIN (SEE HARDWARE GROUP) - ENSURE DOOR AND HARDWARE ARE FULLY OPERATIONAL AND REPAIR AS REQUIRED - PROVIDE TOILET ROOM ACCESSIBLE SIGNAGE - SIGN TYPE SHALL BE RAISED BRaille AND PICTORIAL SYMBOL SIGN 60" A.F.F. ON WALL ADJACENT TO LATCH SIDE OF DOOR. |
| 5 | REAR DOOR | EXIST. 3'-0" X 7'-0" X 1 3/4" | EXISTING | SEE NOTE 11 | - | EXISTING | SEE NOTE 11 | - | 4 | G.C. | G.C. | EXISTING HARDWARE TO REMAIN (SEE HARDWARE GROUP) - ENSURE DOOR AND HARDWARE ARE FULLY OPERATIONAL AND REPAIR AS REQUIRED - SEAL EXTERIOR EDGES OF EXISTING THRESHOLD WEATHERTIGHT TO PAVEMENT |
| 6 | CORRIDOR | 3'-0" X 7'-0" X 1 3/4" | HOLLOW METAL | MATCH ADJACENT WALL FINISH | B1 | HOLLOW METAL | MATCH ADJACENT WALL FINISH | 7/A5.0 | 2 | G.C. | G.C. | |

1. FURNISH ALL FINISH HARDWARE AS REQUIRED BUT NOT LIMITED TO BUTTS, LOCK SETS, CLOSURES, STOPS, THRESHOLDS, SILENCERS, WEATHER-STRIPPING, CYLINDERS MASTER-KEYED, PUSHERS, PULLS, KICK PLATES, ETC. SEE HARDWARE GROUPS.

2. FOR FIRE-RATED OPENINGS PROVIDE UL TESTED AND LISTED HARDWARE (NFPA STANDARD 80).

3. ALL HARDWARE SHALL COMPLY WITH A.D.A. GUIDELINES.

4. HARDWARE MOUNTING HEIGHTS: DOOR HARDWARE SHALL BE LOCATED WITHIN GUIDELINES AS PRESENTED BY THE DOOR AND HARDWARE INSTITUTES' RECOMMENDED LOCATIONS FOR BUILDERS HARDWARE' AND A.D.A. GUIDELINES.

5. SIZE AND MOUNT HARDWARE TO COMPLY WITH MANUFACTURER'S RECOMMENDATIONS.

6. INSTALL EACH HARDWARE ITEM TO COMPLY WITH MANUFACTURER'S RECOMMENDATIONS.

7. KEYING: SEE DOOR HARDWARE NOTES.


8. MANUALLY OPERATED EDGE OR SURFACE FLUSH BOLTS AND SURFACE BOLTS ARE PROHIBITED. WHEN EXIT DOORS ARE USED IN PAIRS, AND APPROVED AUTOMATIC FLUSH BOLTS ARE USED, THE DOOR LEAF HAVING THE AUTOMATIC FLUSH BOLTS SHALL HAVE NO DOOR KNOB OR SURFACE MOUNTED HARDWARE. THE UNLATCHING OF ANY LEAF SHALL NOT REQUIRE MORE THAN ONE OPERATION.

9. EXIT DOORS SHALL BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT.

10. DOOR HANDLES SHALL BE LEVER TYPE, PUSH/PULL, OR EQUIVALENT. MAXIMUM EFFORT TO OPERATE DOORS SHALL NOT EXCEED 5 LBS.

11. FINISH INTERIOR SURFACES OF DOOR AND FRAME TO MATCH ADJACENT WALL FINISH. FINISH EXTERIOR SURFACES OF DOOR AND FRAME TO MATCH LANDLORD STANDARD FINISHES.

DOOR SCHEDULE

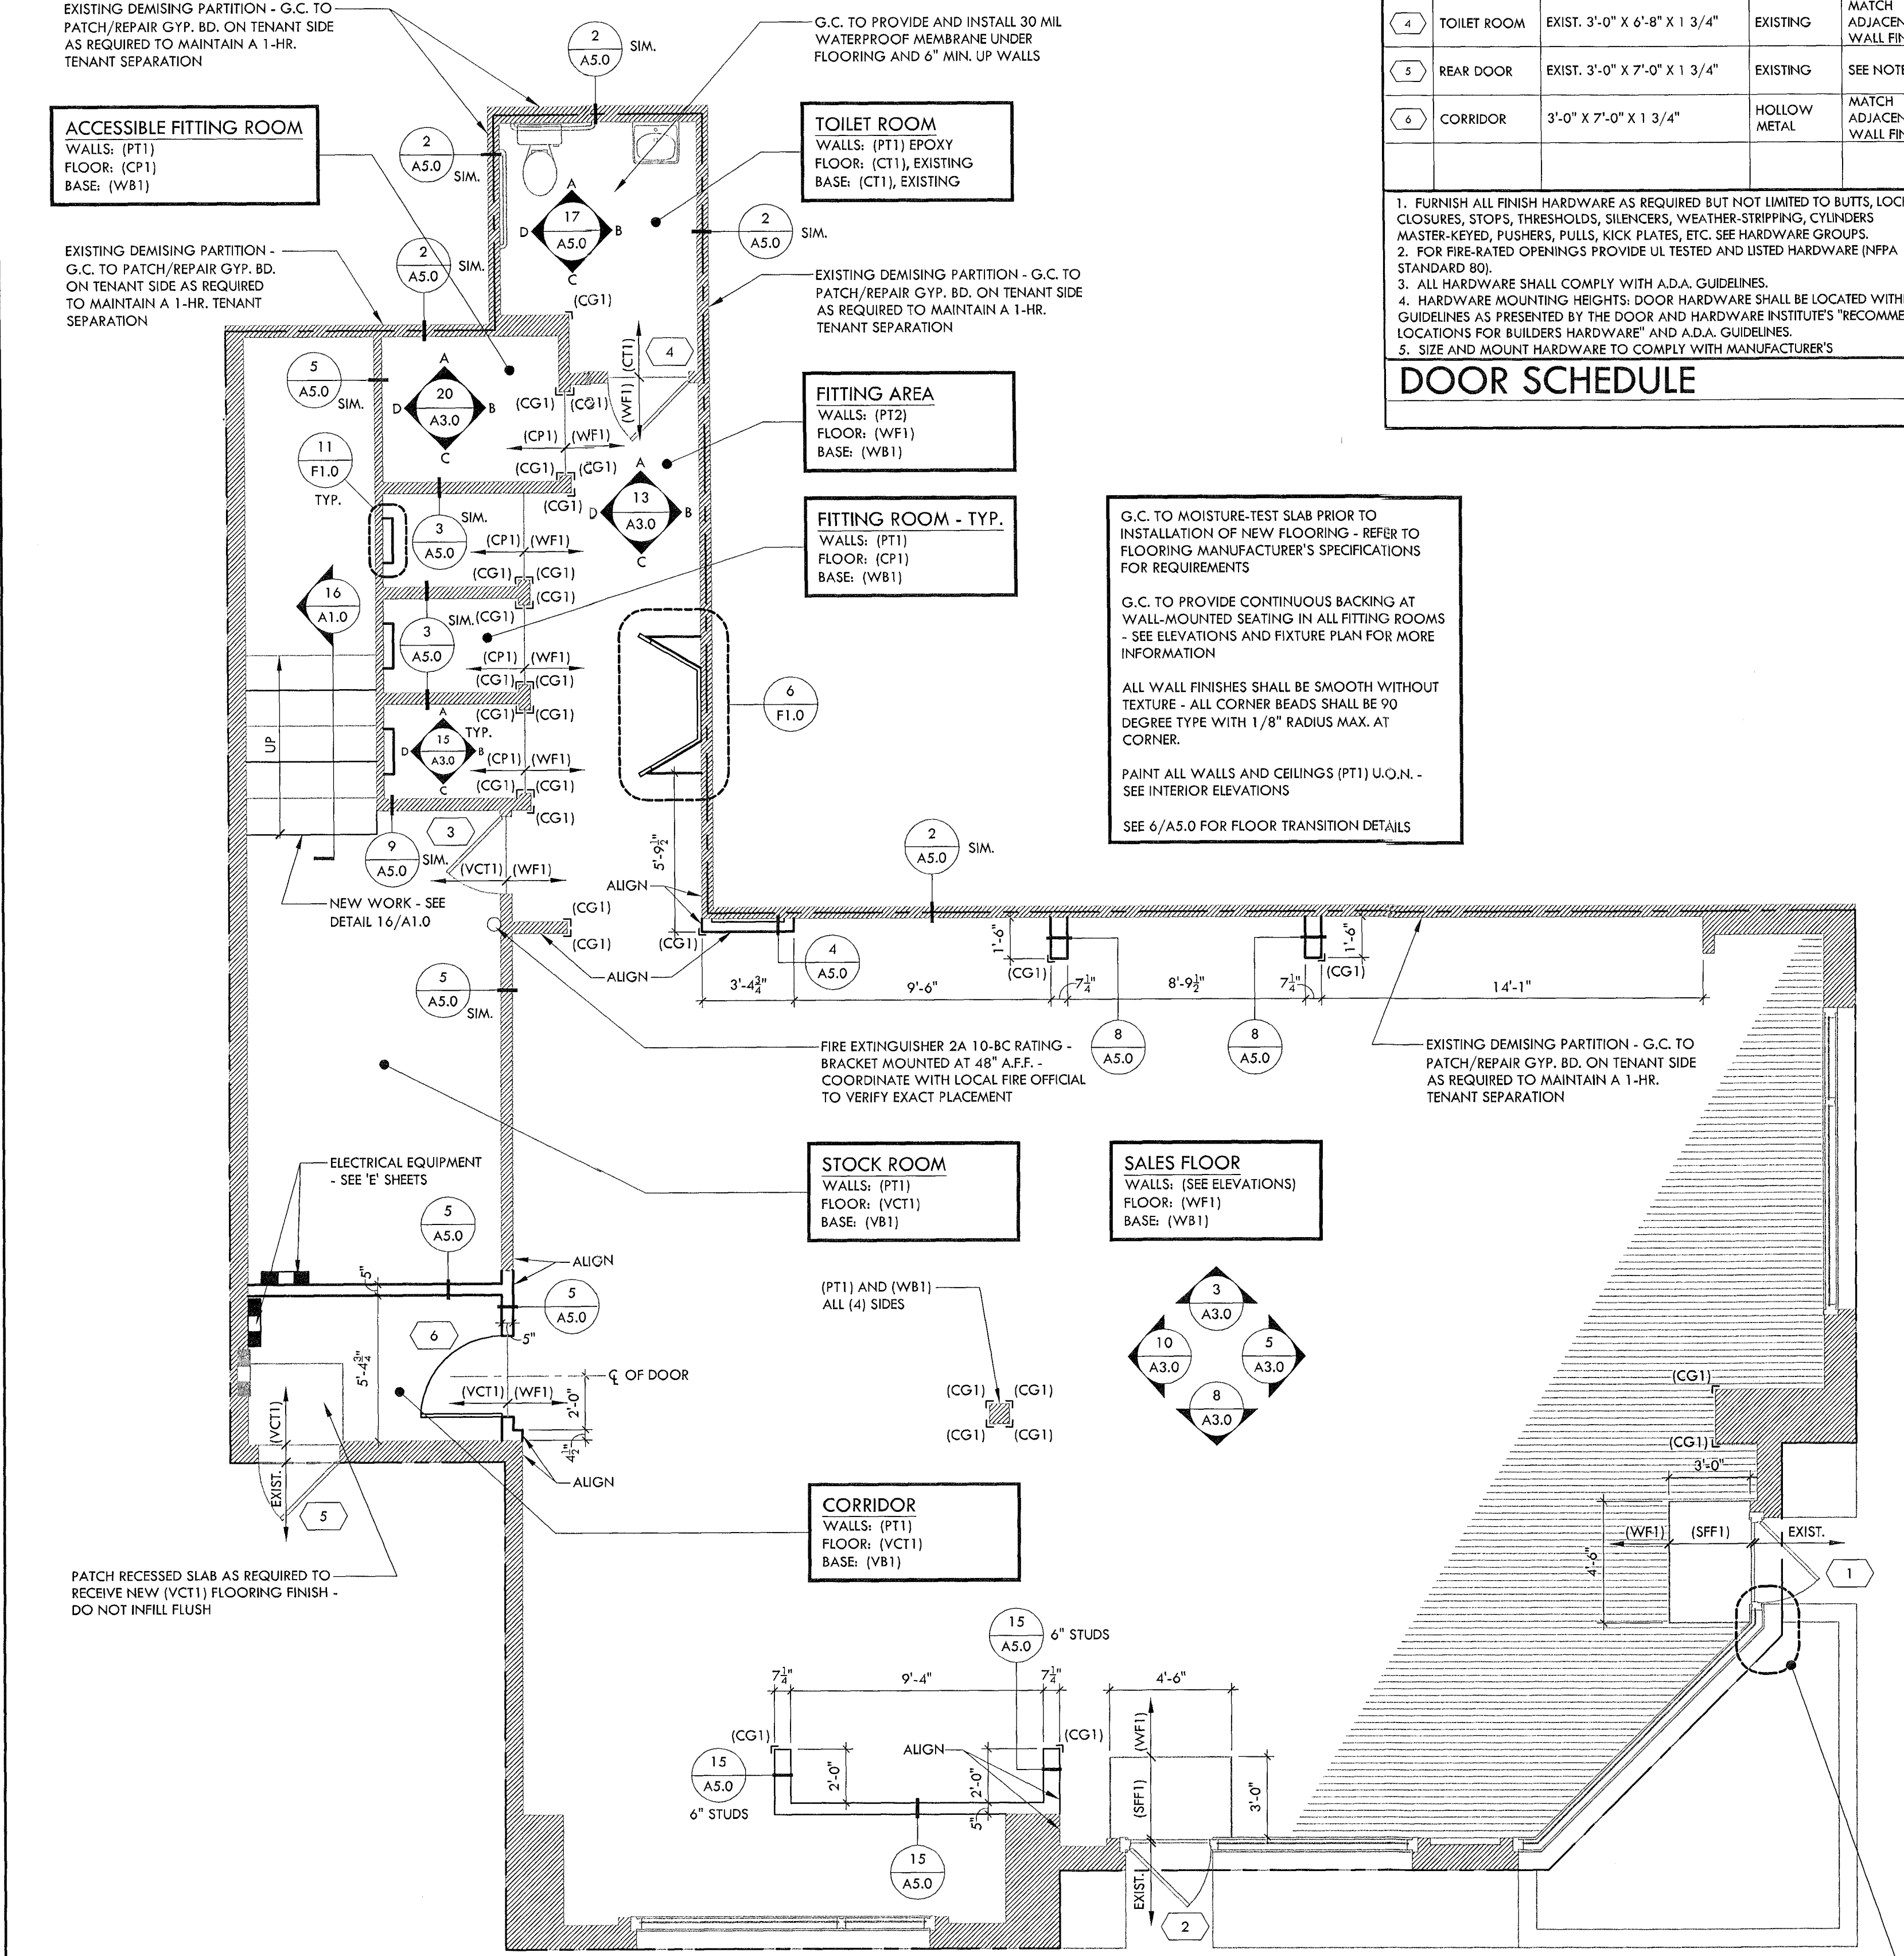

20 FLOOR PLAN
SCALE 1/4" = 1'-0"

GROUP 1 (STOREFRONT) - EACH TO RECEIVE (IF NOT INDICATED AS EXISTING)

1 SET ADJUSTABLE SURFACE-MOUNTED FLOOR SWEEPS
2 EA. CLOSERS (EXISTING)
1 EA. DEADBOLT LOCK, #5 U-CHANGE CYLINDER WITH INTERIOR THUMB TURN (EXISTING)

1 1/2 PR. BUTT HINGES 5" (EXISTING)
2 SETS PUSH/PULL (EXISTING)
1 SET WEATHERSTRIPPING
1 EA. THRESHOLD (EXISTING)

GROUP 2 (STOCK ROOM/CORRIDOR) - EACH TO RECEIVE (IF NOT INDICATED AS EXISTING)

1 1/2 PR. HINGES - 4 1/2" X 4 1/2" (EXISTING AT DOOR #3 ONLY)
1 EA. PASSAGE LEVER SET (EXISTING AT DOOR #3 ONLY)
1 EA. CLOSER - LGN 4041
1 EA. KICKPLATE - 12" HIGH STAINLESS STEEL

GROUP 3 (TOILET ROOM) - EACH TO RECEIVE (IF NOT INDICATED AS EXISTING)

1 1/2 PR. HINGES 4 1/2" X 4 1/2" (EXISTING)
1 EA. LEVER PRIVACY LOCK SET (EXISTING)
1 EA. KICKPLATE - 12" HIGH STAINLESS STEEL
1 EA. WALL STOP (EXISTING)
1 EA. CLOSER

GROUP 4 (REAR DOOR) - EACH TO RECEIVE (IF NOT INDICATED AS EXISTING)

1 1/2 PR. HINGES - 4 1/2" X 4 1/2"
1 EA. SELF-LATCHING DETEX PUSH BAR PANIC HARDWARE (ECL 8010) WITH INTERIOR #5 U-CHANGE CYLINDER LOCK ON ALARM CLOSER (EXISTING)
1 EA. FULL HANDLE AT EXTERIOR (EXISTING)
1 EA. PEEPHOLE - MOUNT AT 54" A.F.F. FLOOR STOP
1 EA. KICKPLATE AT PUSH SIDE - 12" HIGH STAINLESS STEEL
1 EA. ADJUSTABLE SURFACE-MOUNTED FLOOR SWEEP
1 EA. LOW-PROFILE ALUMINUM THRESHOLD (EXISTING)


NOTE: ALL DOOR HARDWARE TO BE BRUSHED STAINLESS STEEL FINISH AND A.D.A. COMPLIANT U.O.N.

HARDWARE GROUPS

- MANUFACTURER'S REFERENCE LIST
- HINGES: HAGER, MCKINNEY, STANLEY (FULL MORTISE) NRP AT EXTERIOR DOORS.
 - LOCKS: SCHLAGE
 - CLOSERS: ICH, NORTON, YALE (COVERS TO MATCH)
 - STOPS AND HOLDERS: IVES, GLYNN-JOHNSON
 - PUSH/PULL/KICK/FLUSH BOLTS: ROCKWOOD, BALDWIN, IVES
 - THRESHOLDS: NATIONAL GUARD, PEMKO, REESE, ZERO
 - PANIC DEVICES: DETEX (PER CODE REQUIREMENTS)
 - SEALS/WEATHER-STRIPPING: ZERO, REESE, PEMKO (WHERE REQUIRED)
 - SIZE AND MOUNT UNITS TO COMPLY WITH MANUFACTURER'S RECOMMENDATIONS FOR THE EXPOSURE CONDITION. REINFORCE THE SUBSTRATE AS RECOMMENDED.
 - INSTALL EACH HARDWARE ITEM TO COMPLY WITH MANUFACTURER'S RECOMMENDATIONS.
 - KEYING: ALL DOORS TO BE RE-KEYED ALIKE. PROVIDE OWNER REP. (S) SETS.

HARDWARE NOTES

DOOR TYPES

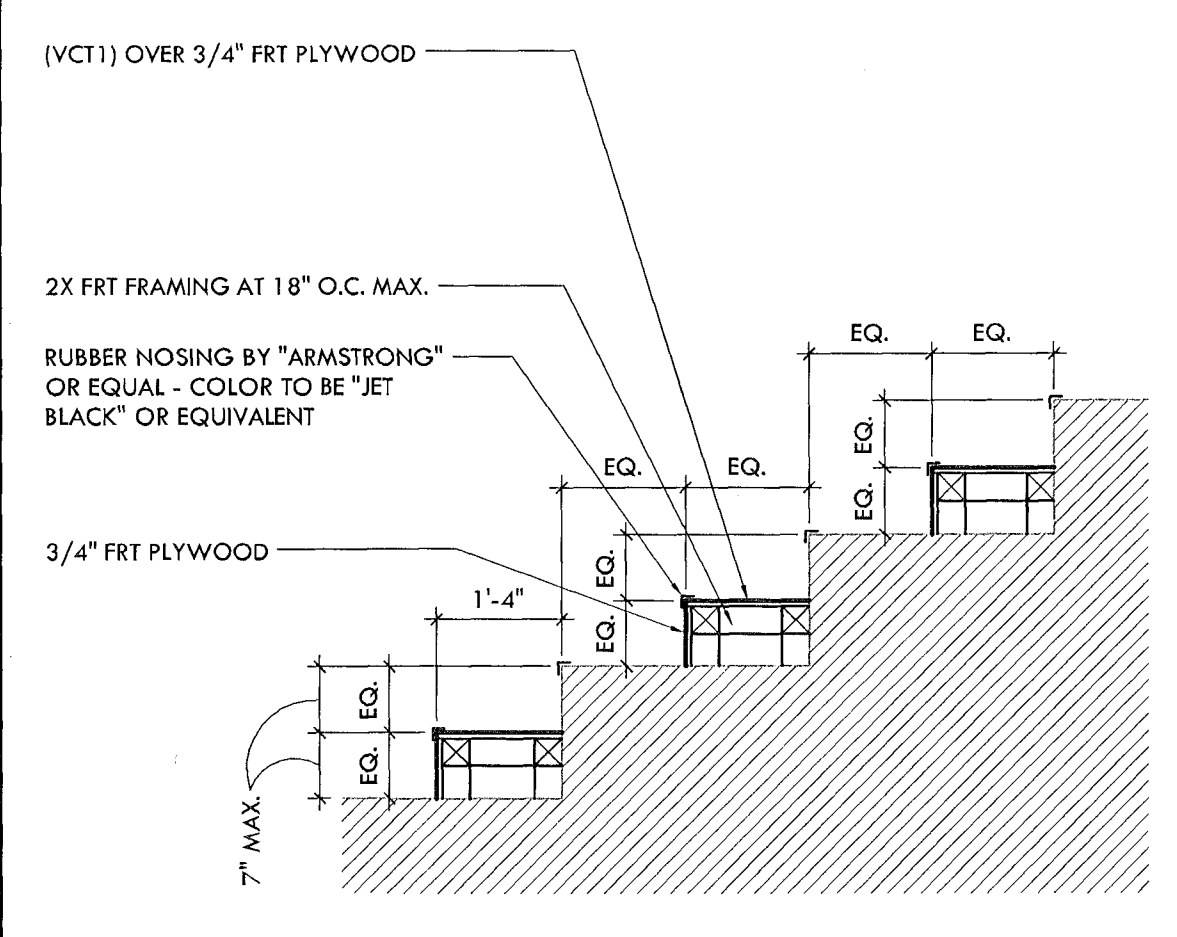

16 DETAIL
SCALE: 1/2" = 1'-0"

17 -
SCALE: